
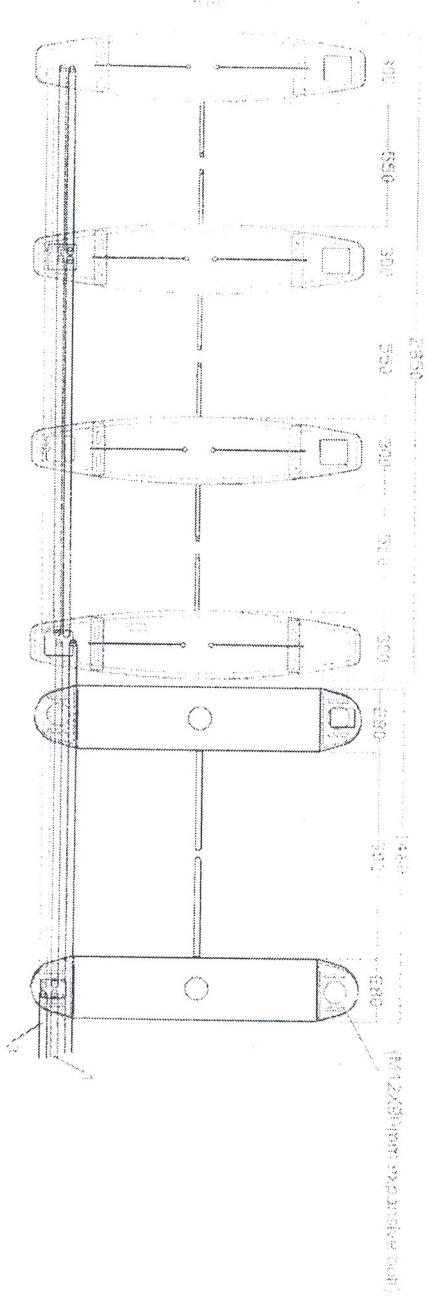
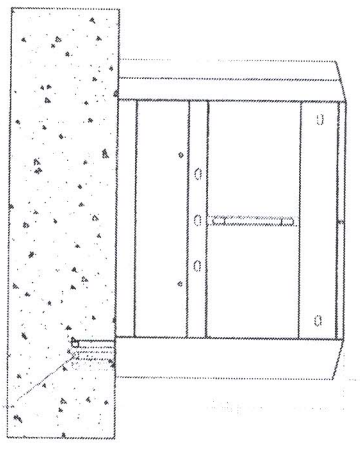


Unit : mm

Annexure B - Representative diagram of the proposed Gales

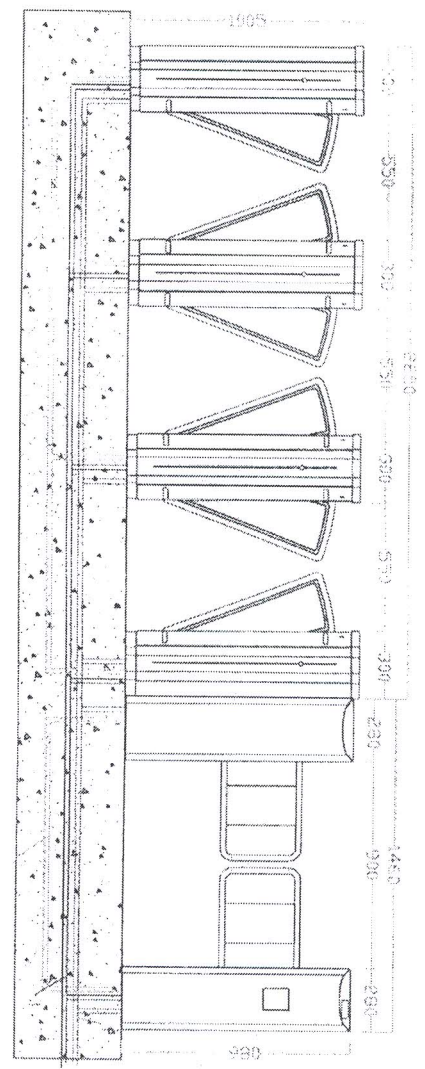

Installation Manual:

1. The 225mm PVC tube for AC 27V or AC 110V Power cable (3 X 102.5mm).
2. The 225mm PVC tube for AC 27V or AC 110V Power cable (3 X 102.5mm).
3. The tube for RS485 wire (2 X 00.5mm), TQPLP wire (8 core), Manually opening the tangle wire (4 X 00.3mm). The signal wire length should be less than 100m.
4. The tube for RS485 wire (2 X 00.5mm), TQPLP wire (8 core), Manually opening the tangle wire (4 X 00.3mm). The signal wire length should be less than 100m.
5. The tube for RS485 wire (2 X 00.5mm), TQPLP wire (8 core), Manually opening the tangle wire (4 X 00.3mm). The signal wire length should be less than 100m.